



Water consumption					
Monthly Consumption	3512 M ³	28	125.43 M ³	Daily Average	
Previous year 2019-12	3382 M ³	28	120.79 M ³	Daily Average	
			3.84%		
Vol Well #1 since 19 Jan 2019	116.16 M ³				
Max Flow for month	1264.2 L/Min	Min Flow for month	0 L/Min (leak rate)		
Time and Date	2020-08-12 11:36		2020-06-12 23:27:00 AM		
Pump hours	# 2 669	# 3 1	#4 4		
Previous month hrs	671	1	6		

Samples					
Activity	Date	Location	Sample type	Result	
Monthly	14/12/2020	7941 Park	Drinking water	✓	Sent to VIHA
Sample /testing		7588 Ships Pt.	Drinking water	✓	
		7576 Tozer	Drinking water	✓	
		Well 2	Raw	✓	
		Well 3	Raw	✓	
		Well 4	Raw	✓	


Operations/Maintenance	
	Weekly Meter readings, CL residuals, run pump 1 collect well levels data
	Monthly Data/report, replace CL membrane, VIHA samples add & order chlorine
30/11/2020	Mount new CL skid to wall and secure plumbing, Mount shelf in CL room for manual & tools
01/12/2020	call out request location theirs and neighbours service lines (excavations)
02/12/2020	Comox water and sewer meeting
03/12/2020	Callout concerned service polly under rd. not secure/connected properly, excavated back to expose and determined free to move in drilled hole under rd.
	Annual maintenance of pressure relief valve in control room
05/12/2020	Add 300uF cap to pump end of well sensor #4 (supressing fluctuations) and monitor
07/12/2020	reset shed door alarm switch, search for pump info in office for Bill T
10/12/2020	Pull #3 sensor and put in well 4, put # 4 sensor in well 3 10m, no fluctuations? Remove caps
	Measure sensor cable length vs PLC reading
	#4 9.45 measured/10.5 PL
	3# 7.6 measured/ 9.1 PLC
15/12/2020	Call out Low CL 6 am monitor (poor mixing at low flow)
19/12/2020	Reset skylink alarm cams and door switched suspect Wi-Fi glitch
29/12/2020	call out Vivian low pressure complaint PH 89.7psi 1st tap before PRV 68psi 2nd tap 67 psi
	NFF recommend call plumber to assess PRV

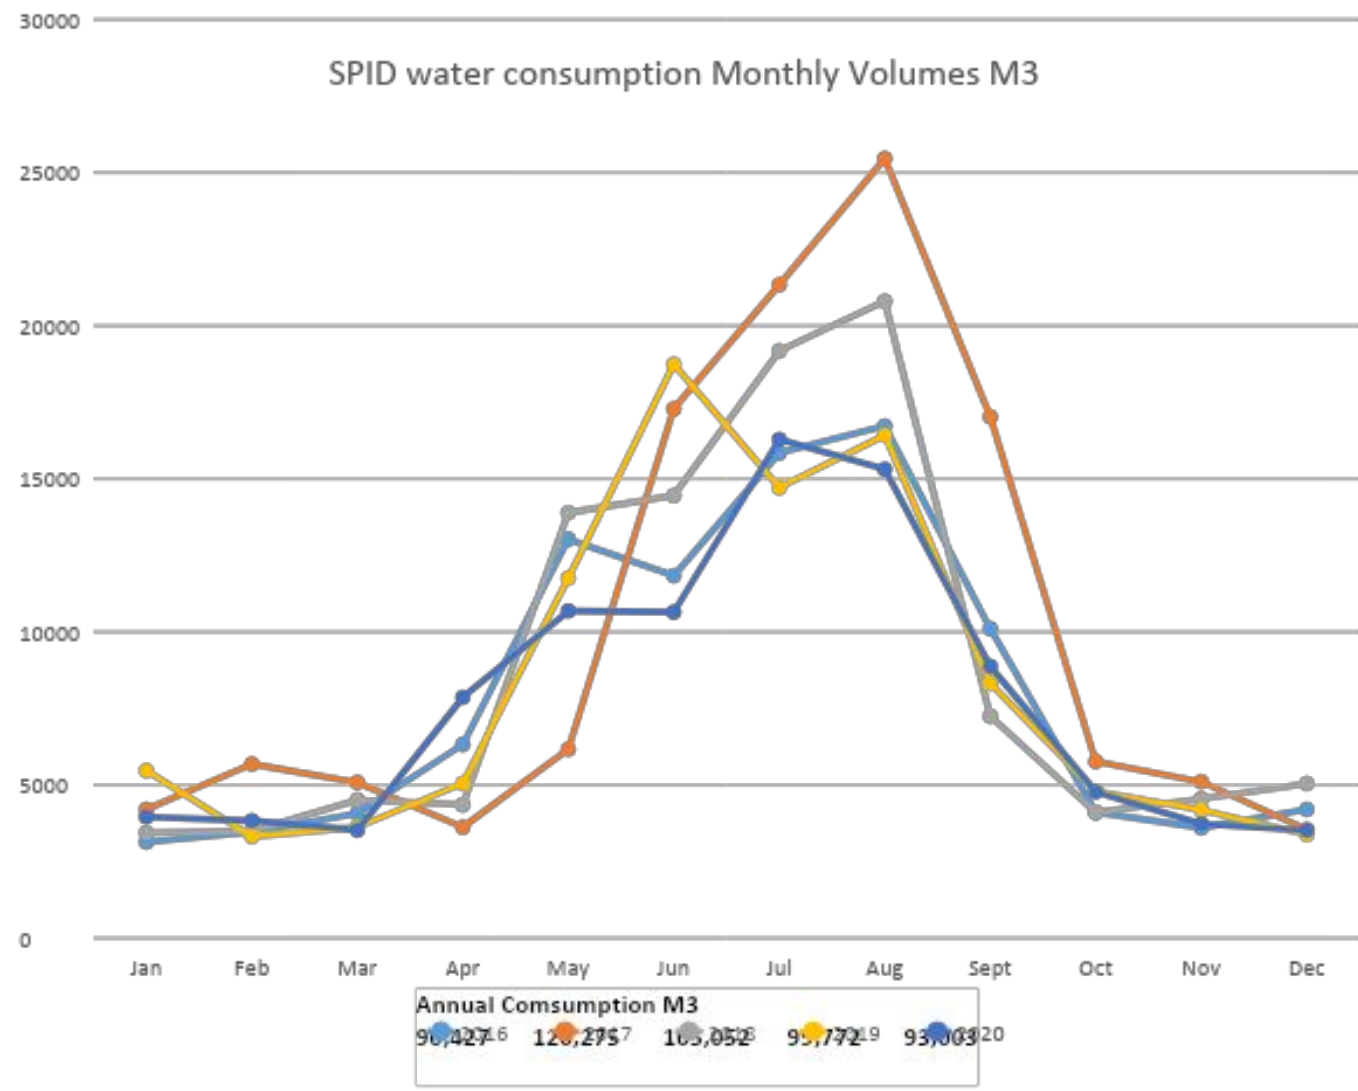


Dec 2020 Flow LPM x 10 & Amps x10

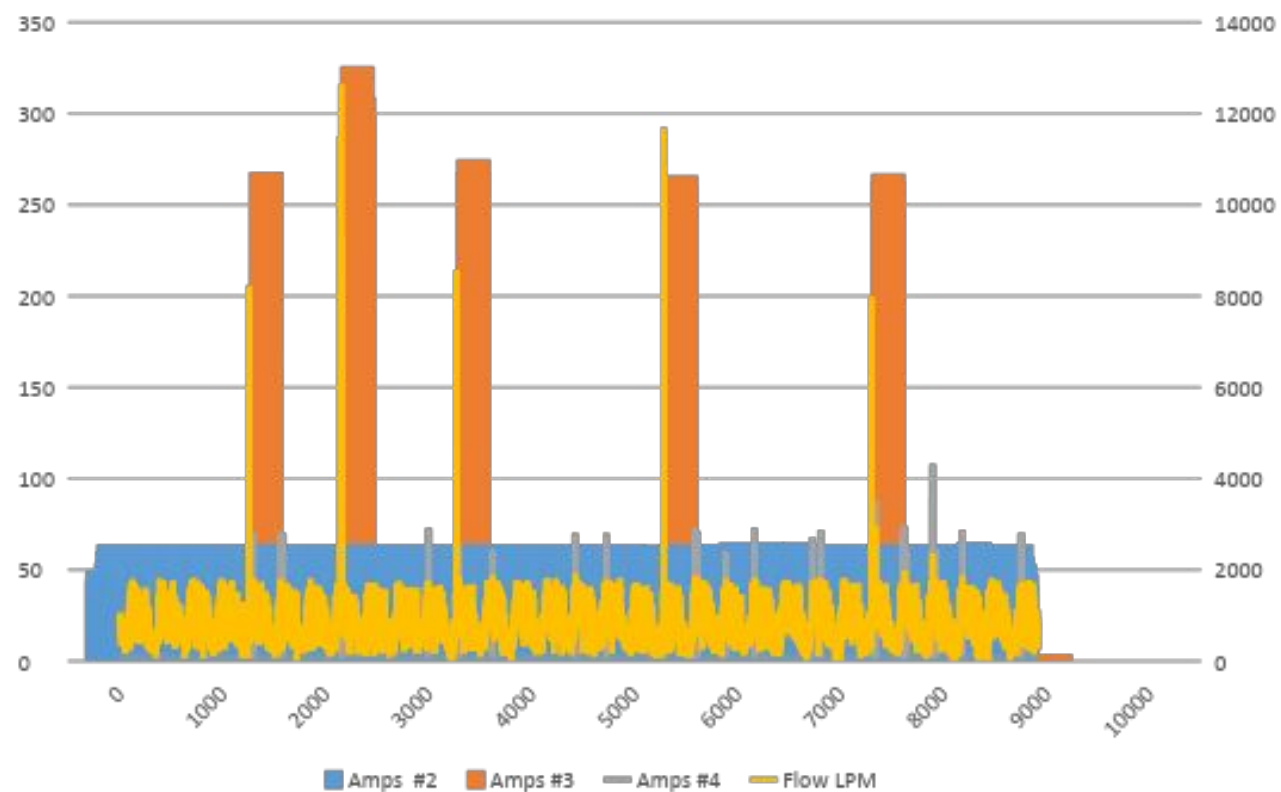


Dec 2020 Well levels M x 10

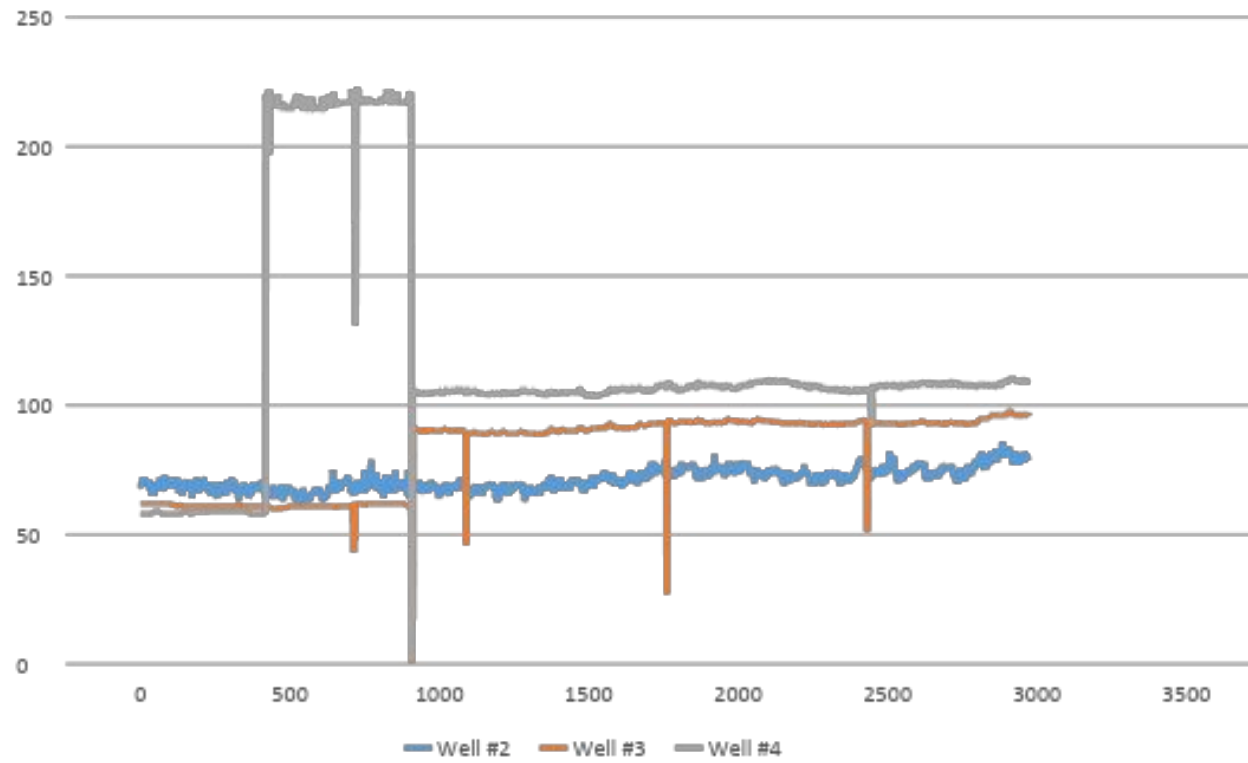


2020 Spid Well Levels Meters Weekly

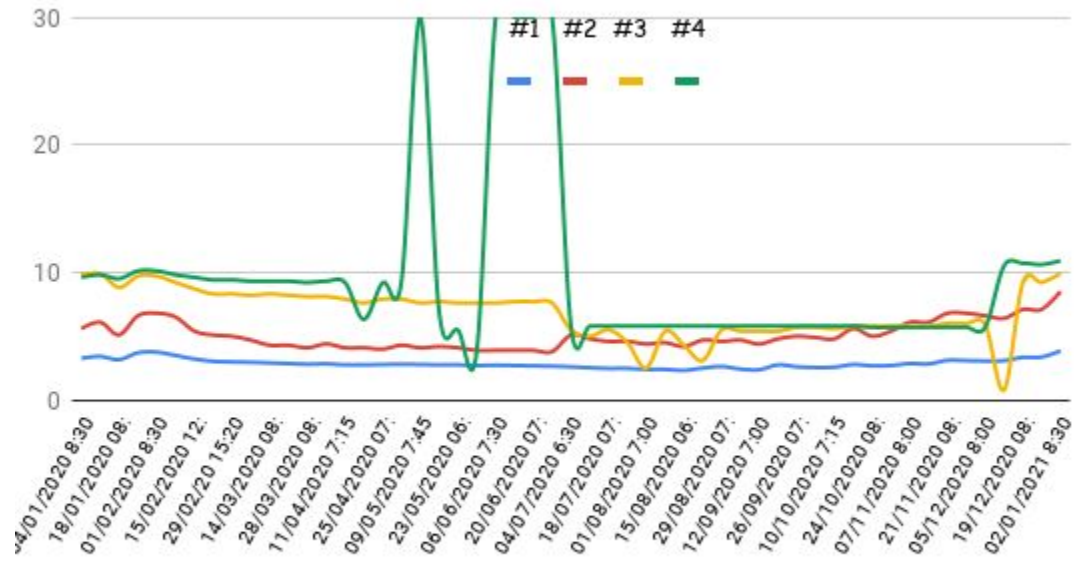


Dec 2020 Chlorine Pumphouse PPM x 1000

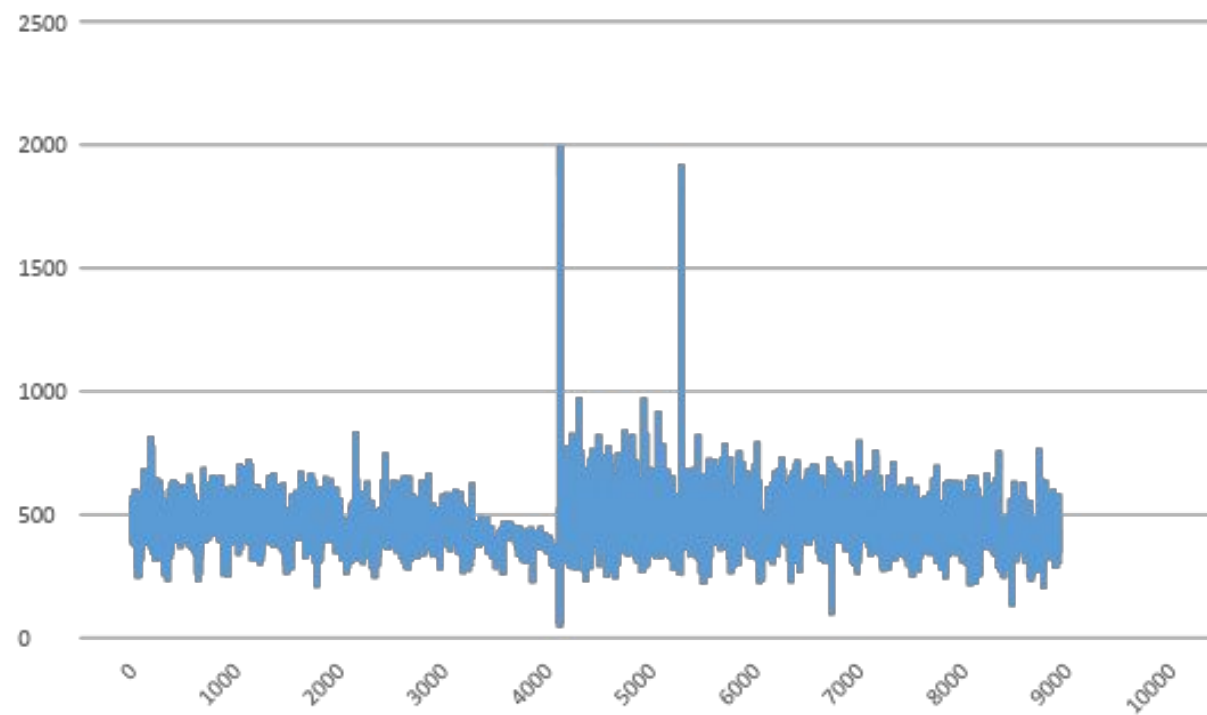

2020 Residual Chlorine weekly testing PPM (parts per million)

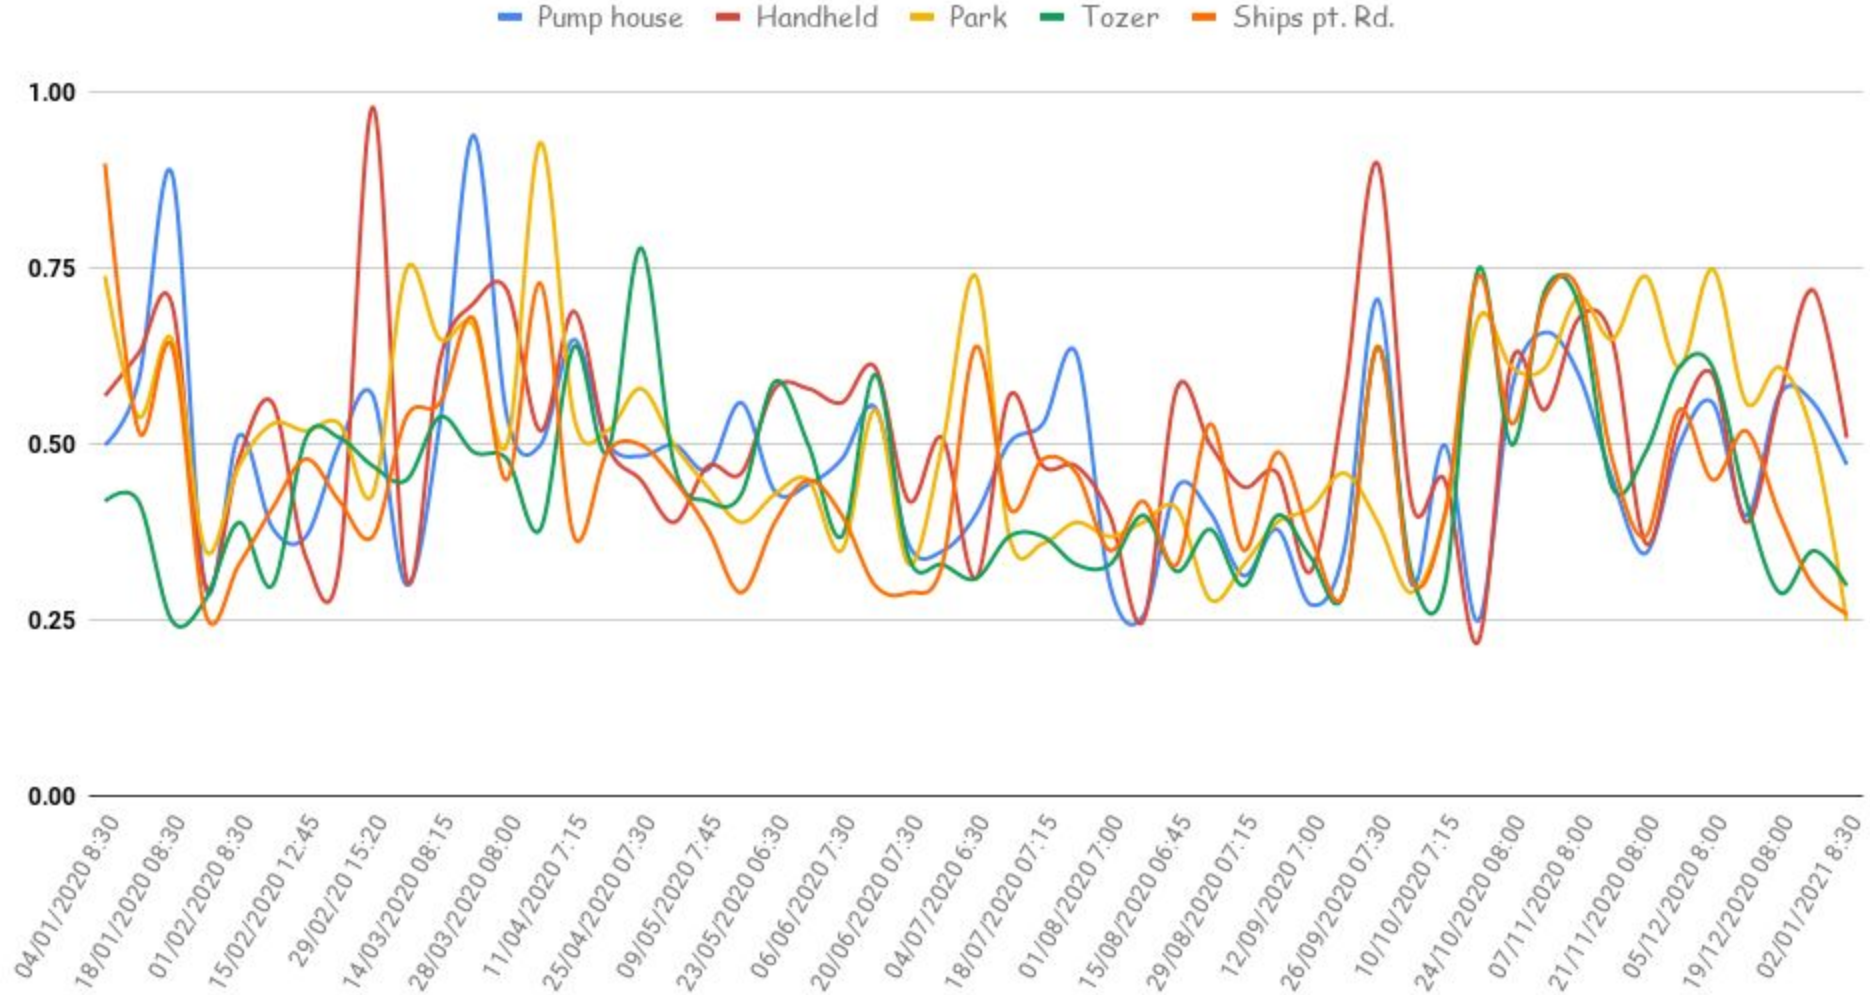

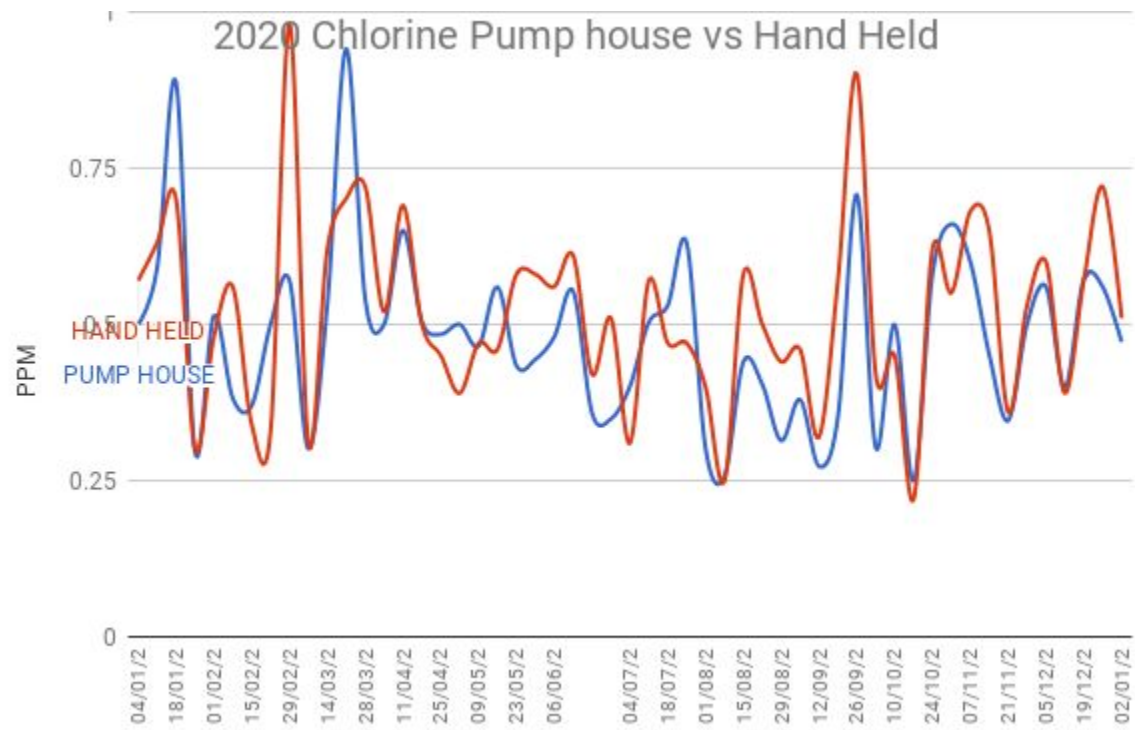

Dec 2020 Discharge pressure PSI

